




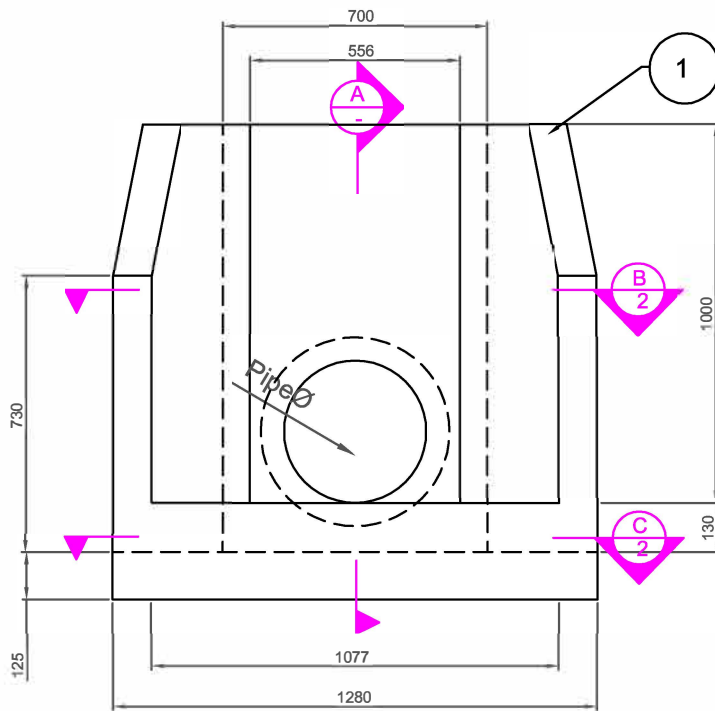



FORNT VIEW 1:20

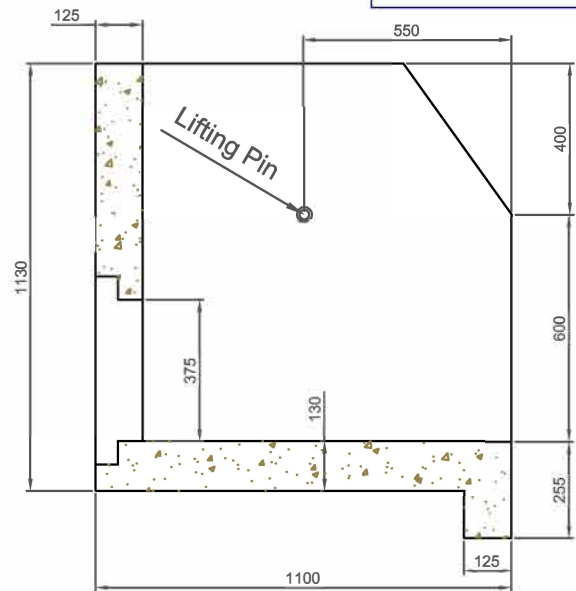

SECTION A-A 1:20

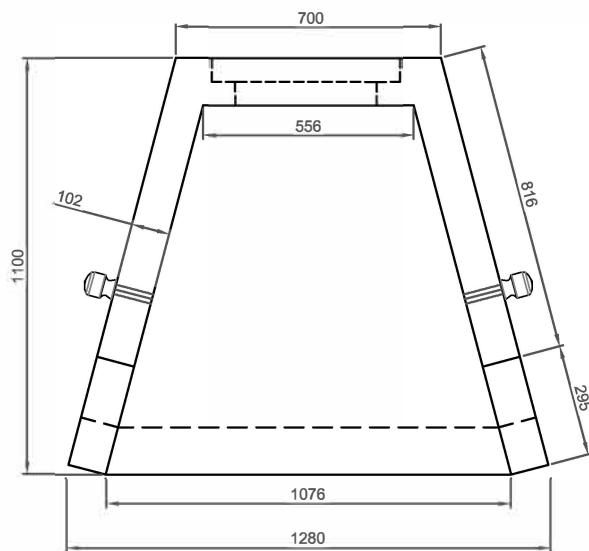

PLAN VIEW 1:20

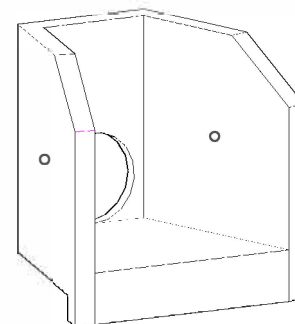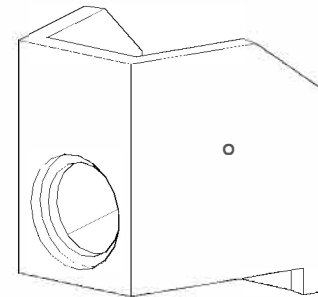

3D VIEW

Specification and General Notes:

1. Manhole design/manufacture to & CSA A23.4 Specification.
2. Concrete testing to current version of ASTM C497/CSA 23.1 & 2.
3. Min. concrete compressive strength 30 MPa with Max. W/C ratio of 0.5.
4. Concrete cover to be Min.25mm.
5. All dimensions to be millimeter.
6. Manufacturing tolerance to be +/- 5mm.
7. Concrete Exposure Class to be A-3.
8. Min. Stripping Strength to be 15MPa.
9. All Form Finish to be Standard Grade.
10. All Unformed Finish to be Steel Trowelled Finish or Wood Float Finish.



Description:

TYPE II HEADWALL

TYPE II HEADWALL# 2200

Project:

Estimated Weight 2200lbs

Drawn :

D.L.

Approved :

V.W.

Rev. No.

A

Date :

30/07/2018

Load Rating:

N/A

Scale :

As Shown

Catalog No.

HWII-375

Dwg. No.

HWII-375-1

Sheet No.

1 OF 2

This drawing is the property of the Diamond Precast Concrete. All information contained herein is confidential and may not be used in whole or in part without written permission from the owner